


GTG Gebläsetechnik GmbH

www.gtg.at

| | | |
|--------------------------|----------------|-------------------------------|
| Projekt : | Datum : | 10.03.2015 |
| Ventilator type : | PHR 355 | Dichte : |
| | | 1.171 kg/m³ |

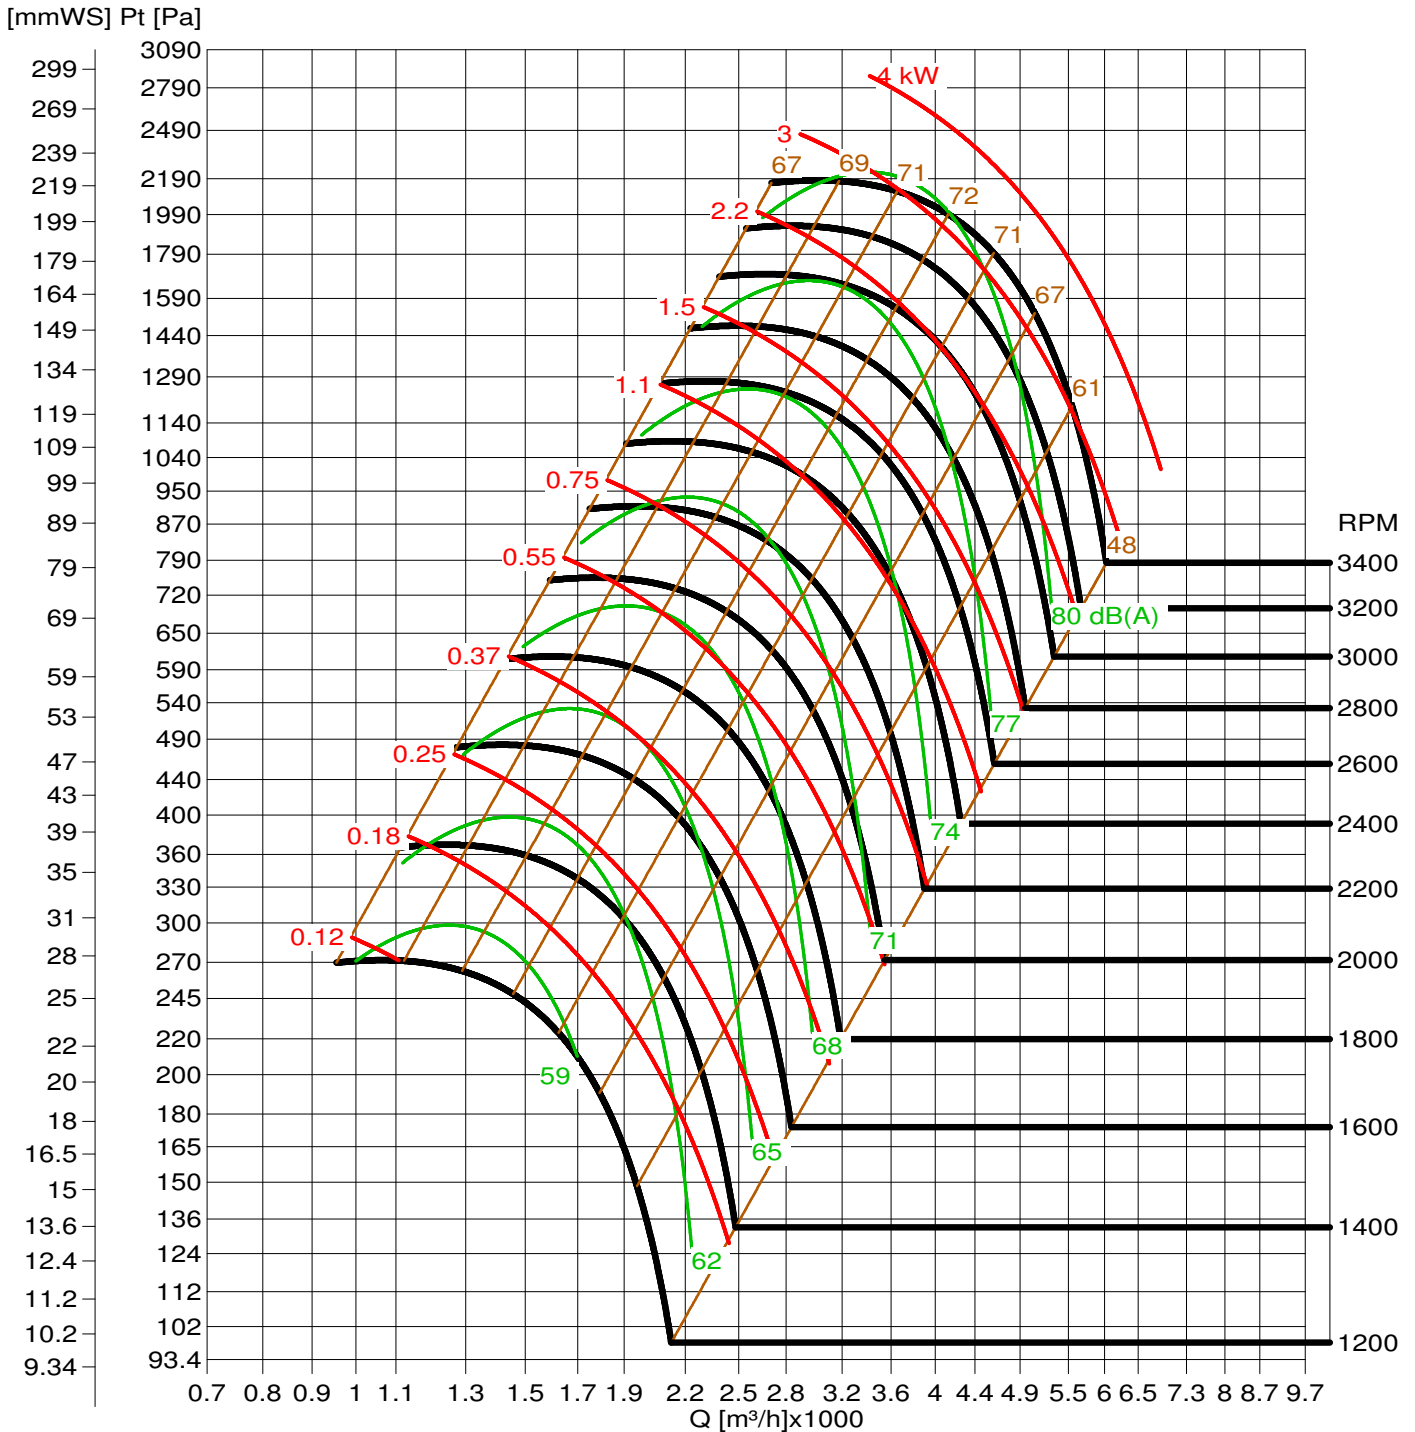

| | | | | | | | | | | | | | | | | | | | | | | | | |
|-----------|-------|-------|------|-------|-------|------|-------|------|-------|------|-------|------|-------|------|------|------|-----|-----|-----|-----|-----|-----|-----|----|
| Q [m³/s] | 0.218 | 0.266 | 0.33 | 0.394 | 0.474 | 0.57 | 0.682 | 0.81 | 0.954 | 1.13 | 1.338 | 1.61 | 1.898 | 2.25 | 2.65 | | | | | | | | | |
| v [m/s] | 2.4 | 2.8 | 3.2 | 3.6 | 4 | 6 | 8 | 10 | 12 | 14 | 16 | 18 | 20 | 22 | 24 | 28 | 32 | | | | | | | |
| Pd [Pa] | 3 | 3.6 | 4.5 | 5.7 | 7.2 | 9 | 11.1 | 14.7 | 19.5 | 25.8 | 33 | 41.4 | 54 | 66 | 81 | 96 | 120 | 153 | 198 | 255 | 327 | 420 | 537 | |
| Pd [mmWS] | 0.3 | 0.4 | 0.5 | 0.64 | 0.86 | 1.1 | 1.4 | 1.8 | 2.3 | 2.9 | 3.6 | 4.5 | 5.6 | 6.9 | 8.5 | 10.9 | 14 | 17 | 21 | 25 | 30 | 36 | 43 | 51 |