


GTG Gebläsetechnik GmbH

www.gtg.at

Projekt : _____ **Datum :** 10.03.2015

Ventilatorart : **VTC 1600** **Dichte :** **1.171 kg/m³**

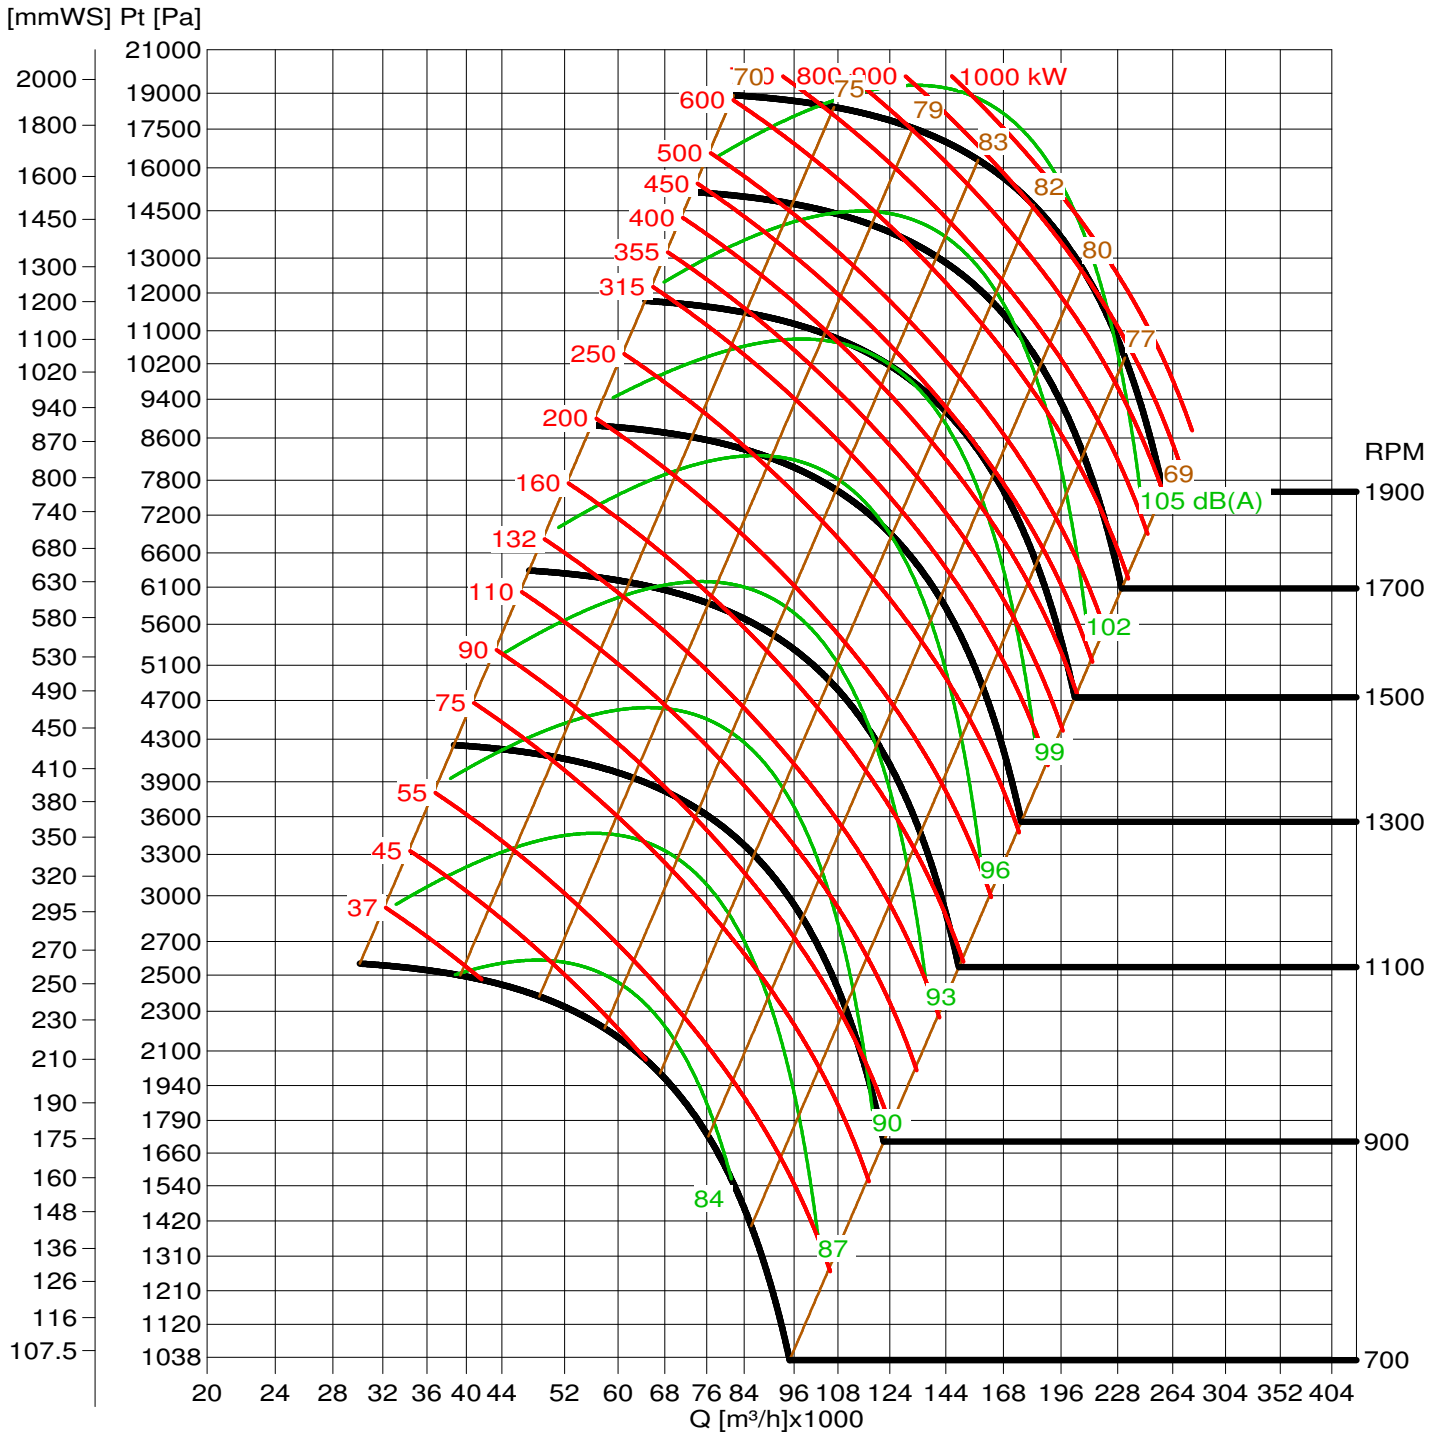

Q [m³/s]	6.2	7.4	8.6	9.8	11	12.8	15.2	18.2	21.8	26	29	32	36.8	43.4	50	56	62	70.4	80	89	98	110			
v [m/s]	6	6.6	7.8	9	10.2	12		18	24	30	36	42	48	54	60	66	78								
Pd [Pa]	12	15	19.5	26.7	36	45	57	69	84	108	144	189	249	327	429	564	741	972	1329	1893	2697	3843			
Pd [mmWS]	1.2	1.6	2.4	3.3	4.6	5.8	7	8.9	11	14	17	21	26	32	39	48	58	71	86	109	143	188	247	325	427